

# Operating instructions

Magnetically coupled centrifugal pump  
 ProMinent® von Taine® 2323 PP and PVDF



von Taine® 2323 PP

von Taine® 2323 PVDF



**Type:**             2323 PP/FKM             2323 PVDF/FKM  
                        2323 PP/EPDM         2323 PVDF/EPDM

**Serial-No.** \_\_\_\_\_

Please enter type + serial number of the pump here !

Please read the manual instructions completely before bringing the machine into service!

Do not throw it away!

Damage caused by an operator's error will cancel the right to all warranty claims!

**Imprint:**

**Operating instructions Magnetically coupled centrifugal pump  
ProMinent® von Taine® 2323 PP and PVDF  
© ProMinent Dosiertechnik GmbH, 2010**

**ProMinent Dosiertechnik GmbH  
Im Schuhmachergewann 5-11  
69123 Heidelberg  
Germany**

[info@prominent.de](mailto:info@prominent.de)  
[www.prominent.de](http://www.prominent.de)

**Specifications subject to change without notice !  
Printed in Germany**

## TABLE OF CONTENTS

<b>1</b>	<b>General information</b>	<b>5</b>
1.1	Authorized use of the pump	5
1.2	Sound intensity level	5
<b>2</b>	<b>Safety</b>	<b>5</b>
2.1	Identification of safety instructions in the operating manual	5
2.2	Qualification and training of operating personnel	6
2.3	Hazards in the event of non-compliance with safety instructions	6
2.4	Compliance with regulations pertaining of safety work	6
2.5	Safety instructions relevant for operation	6
2.6	Safety instructions relevant for maintenance, inspection and assembly work	6
2.7	Unauthorized alterations and production of spare parts	7
2.8	Unauthorized modes of operation	7
<b>3</b>	<b>Transportation and storage</b>	<b>7</b>
3.1	Transportation	7
3.2	Storage	7
3.3	Ambient conditions required for transportation and storage	7
<b>4</b>	<b>Functional characteristics</b>	<b>7</b>
4.1	General description	7
4.2	Design	7
4.3	Materials	8
<b>5</b>	<b>Mounting and installation</b>	<b>8</b>
5.1	Examples of mounting	8
5.2	Hoses and tubes	8
5.2.1	The suction line	8
5.2.2	The delivery line	8
5.3	Electrical connection	9
<b>6</b>	<b>Starting and shutdown procedures</b>	<b>9</b>
6.1	Preparations for starting	9
6.2	Starting procedure	10
6.3	Operation	10
6.4	Shutdown procedure	10
6.5	Safe disposal of waste parts	10
<b>7</b>	<b>Maintenance</b>	<b>10</b>
7.1	General information	10
7.2	Preventive maintenance	11

7.3	Disassembly of the pump .....	12
7.4	Re-assembly of the pump .....	13
<b>8</b>	<b>Troubleshooting .....</b>	<b>15</b>
<b>9</b>	<b>Technical data.....</b>	<b>16</b>
<b>10</b>	<b>Spare parts .....</b>	<b>17</b>
10.1	Exploded view .....	17
10.2	Bill of materials von Taine® 2323 PP/FKM .....	18
10.3	Bill of materials von Taine® 2323 PVDF/FKM .....	18
10.4	Bill of materials von Taine® 2323 PP/EPDM .....	19
10.5	Bill of materials von Taine® 2323 PVDF/EPDM .....	19
<b>11</b>	<b>Appendix.....</b>	<b>20</b>
11.1	Dimensional drawing von Taine® 2323 PP and PVDF .....	20
11.2	Characteristic curves.....	21
11.3	Motor data sheet .....	22
11.4	EC Declaration of Conformity.....	23

## 1 General information

The pump may only be used in the range of applications authorized by the manufacturer. In case of modified operating conditions, please consult your supplier and / or the manufacturer.

### 1.1 Authorized use of the pump

- Delivery of low-viscosity liquids resembling water.
- Delivery of acids, alkaline solutions etc.
- Delivery of gaseous fluids.
- No other than the authorized use nor any conversion of the pump are permitted.

#### WARNING

***Make sure that the materials used for the pump are resistant to the fluids being delivered!  
(see the ProMinent list of resistances)***

- If you deliver crystallising fluids, make sure that the fluid does not crystallise within the pump. Should this happen, carefully clean all parts being in contact with the fluid once the pump has been shut off.

#### NOTE

***Disassembly of the pump will cancel the right to all warranty claims!***

### 1.2 Sound intensity level

The sound intensity level of this pump is < 70 dB (A) according to DIN EN 12639 (noise measurement of liquid pumps and pump units).

## 2 Safety

This operating manual gives basic instructions which are to be observed during installation, operation and maintenance of the pump. It is therefore imperative that the manual be read by the responsible personnel / operator prior to assembly and commissioning. It is always to be kept available at the installation site.

It is not only the general safety instructions contained under this main heading safety that are to be observed but also the specific information provided under the other main headings.

### 2.1 Identification of safety instructions in the operating manual

Safety instructions given in this manual non-compliance with which would affect safety are identified by the following symbol



(see DIN 4844-W9)

or where electrical safety is involved with



(see DIN 4844-W8)

Instructions non-compliance with which would give rise to malfunctioning of the machinery are identified by the word

#### WARNING

It is imperative that signs affixed to the machine, e.g.

- ☞ arrow indicating the direction of rotation
- ☞ symbols indicating fluid connection
- ☞ Warnings to protect the pump from dry-running.

be observed and kept legible.

## 2.2 Qualification and training of operating personnel

The personnel responsible for operation, maintenance, inspection and assembly must be adequately qualified. Scope of responsibility and supervision of the personnel must be exactly defined by the plant operator. If the staff does not have the necessary knowledge, they must be trained and instructed, which may be performed by the machine manufacturer or supplier on behalf of the plant operator. Moreover, the plant operator of the operating manual are fully understood by the personnel.

## 2.3 Hazards in the event of non-compliance with safety instructions

Non-compliance with the safety instructions may produce a risk to the personnel as well as to the environment and the machine and results in a loss of any right to claim damages.

For example, non-compliance may involve the following hazards:

- ☞ Failure of important functions of the machine / plant.
- ☞ Failure of specified procedures of maintenance and repair.
- ☞ Exposure of people to electrical, mechanical and chemical hazards.
- ☞ Endangering the environment owing to hazardous substances being released.

## 2.4 Compliance with regulations pertaining of safety work

When operating the pump, the safety instructions contained in this manual, the relevant national accident prevention regulations and any other service and

safety instructions issued by the plant operator are to be observed.

## 2.5 Safety instructions relevant for operation

- ☞ If hot or cold machine components involve hazards, they must be guarded against accidental contact.
- ☞ Guards for moving parts (e.g. coupling) must not be removed from the machine while in operation.
- ☞ Any leakage of hazardous (e.g. explosive, toxic, hot) fluids must be drained away so as to prevent any risk occurring to persons or the environment. Statutory regulations are to be complied with.
- ☞ Hazards resulting from electricity are to be precluded (see, for example, the VDE Specifications and the bye-laws of the local power supply utilities).

## 2.6 Safety instructions relevant for maintenance, inspection and assembly work

It shall be the plant operator's responsibility to ensure that all maintenance, inspection and assembly work is performed by authorized and qualified personnel who have adequately familiarized themselves with the subject matter by studying this manual in detail.

Any work on the machine shall only be performed when it is at a standstill, it being imperative that the procedure for shutting down the machine described in this manual be followed.

Pumps and pump units which convey hazardous media must be decontaminated. On completion of work all safety and protective facilities must be re-installed and made operative again.

Prior to restarting the machine, the instructions listed under 'Initial commissioning' are to be observed.



***The pump is magnetically coupled.  
Attention: Coming in contact with permanent magnetic parts during repair or maintenance work dangerously exposes to magnetic forces which, for example, may influence pacemakers.  
Keep your distance!***

## 2.7 Unauthorized alterations and production of spare parts

Any modifications may be made to the machine only after consultation with the manufacturer. Using spare parts and accessories authorized by the manufacturer is in the interest of safety. Use of other parts may exempt the manufacturer from any liability.

## 2.8 Unauthorized modes of operation

The reliability of the machine delivered will be only guaranteed if it is used in the manner intended, in accordance with clause 1 of this manual. The limit values specified in the data sheet must under no circumstances be exceeded.

## 3 Transportation and storage

### 3.1 Transportation

The pump is delivered by the manufacturer in a ready-to-work state. In the event of damages occurring during and due to transportation, the forwarding agent must make a factual statement. The pump should always be transported appropriately and according to the state of the art.

### 3.2 Storage

An eventual storage place must be absolutely dry. Make sure that the interior of the pump is protected from pollutants.

### 3.3 Ambient conditions required for transportation and storage

Temperature range: -10°C to 50°C.  
Humidity of the air: max. 95 % relative humidity, non-condensing.

## 4 Functional characteristics

### 4.1 General description

This magnetically coupled centrifugal pump type von Taine® is a sucking single-stage centrifugal pump made of plastics and designed in modular system for horizontal mounting. The pump and electric motor are connected by a magnetic clutch which transmits the drive power to the impeller.

### 4.2 Design

The pump housing, impeller, impeller magnet, and magnet dividing housing are made of plastics. In the standard version, the center shaft is constructed from oxide ceramic whereas the bearings are made of oxide ceramic. The magnet dividing housing hermetically seals the fluid against all atmospheric influences. Due to the magnetic power transmission, the center shaft needs not to be sealed. In contrast to mechanically or gland sealed pumps, this system prevents any leakage of fluid at the shaft.


The pump housing parts are sealed by static o-rings. The impeller of the pump is a radial-flow wheel. Depending on the fluid to be delivered, each component of the pump is available in various materials.

**NOTE**

**The materials used are listed on the name plate or the delivery note!**

**4.3 Materials**

Type	2323 PP	2323 PVDF
Pump housing	PP	PVDF
Impeller	PP	PVDF
Impeller magnet	PP	PVDF
Rear casing	PP	PVDF
Center shaft	oxide ceramic	
Bearing	oxide ceramic	
Static packings	FKM or EPDM	

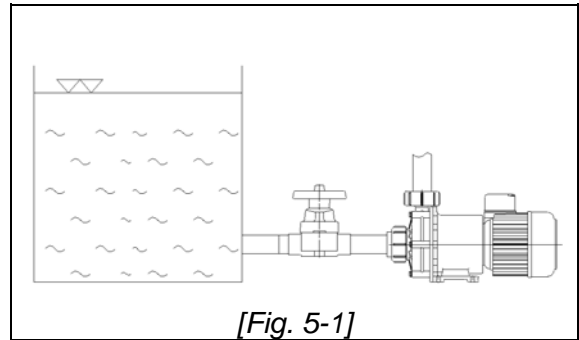

**5.2 Hoses and tubes**

The cross-sections of the tubes must correspond to the suction and delivery ports. All suction and delivery tubes to the pump housing should be free of tensile stress. The weight of the tubes must not rest on the housing!

**WARNING**

**Do not install any quick-acting stop valves into the tubes! Pressure jerks may damage the pump housing.**

**5 Mounting and installation**

The pump should be installed at a place allowing easy access at all times. Make sure to meet the following values:

Ambient temperature	-10 °C up to +40 °C
Humidity of the air:	95 % relative humidity, non-condensing

**5.1 Examples of mounting**

The pump is set up to be mounted horizontally, but may also be mounted vertically, with the motor component pointing upwards.

This pump is not self-priming and therefore requires a feed supply.

**5.2.1 The suction line**

- ☞ The suction line must be a tube or hose which cannot be deformed by the resulting partial vacuum or by high temperatures.
- ☞ The suction line must be a tube or hose which cannot be deformed by the resulting partial vacuum or by high temperatures.
- ☞ When dimensioning the tubes, fittings etc., make sure that the flow resistances are kept as low as possible.
- ☞ The flow velocity within the piped suction line should not exceed the limit of 1m/s

**5.2.2 The delivery line**


- ☞ The standard flow velocity within the suction line is 3m/s.



- ☞ To be able to adjust the flow rate, we recommend the installation of a control element inside the delivery line.

### 5.3 Electrical connection

The motors should be connected according to the following illustration:

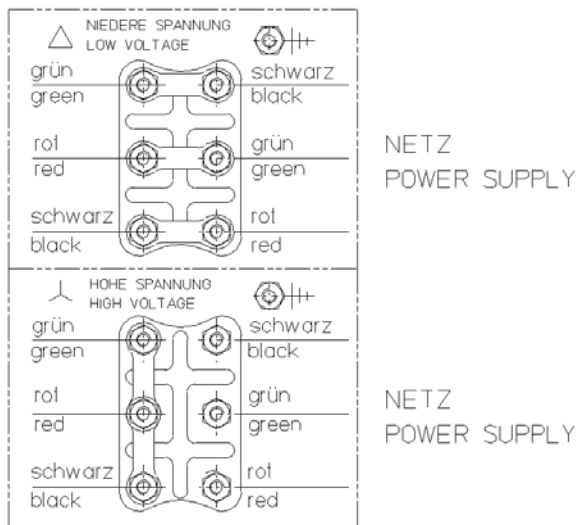


[Fig. 5-2]



**All electrical connections to the pump may only be performed by experts!**

- ☞ The direction of rotation indicated by an arrow on the pump must be respected and controlled after installation.

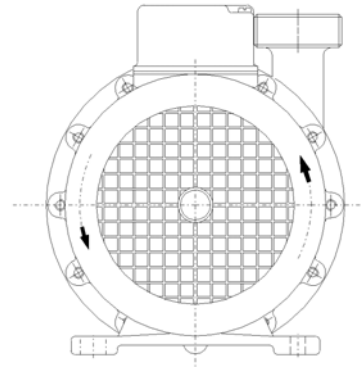

[Fig. 5-3]

#### WARNING

**Do not check the direction of rotation without having filled fluid in the pump!**

- ☞ The motor must be equipped with a motor protection switch.
- ☞ The power supply must have been cut for at least 5 minutes before you may start any work at the terminal box of the pump.
- ☞ Make sure that the data given on the name plate corresponds to the existing power supply.
- ☞ All electrical connections and installations of additional protection devices should be performed by an expert in accordance with the instructions of the local power suppliers and / or the Association of German Electrotechnical Engineers VDE.

## 6 Starting and shutdown procedures

### 6.1 Preparations for starting

- ☞ The pump housing and the suction line must be filled with water or the fluid to be delivered.

#### WARNING

**Avoid any dry-running of the pump!**

### NOTE

***We recommend installing dry-running protection devices such as flow indicators, contact manometers, differential pressure switches or level controllers!***

- ☞ Tighten all screwed connections and fittings.
- ☞ Entirely open all shut-off devices of the suction and delivery lines.

## 6.2 Starting procedure

- ☞ Switch on the motor.
- ☞ Check the direction of rotation of the motor by switching it on and off in immediate succession. The direction of rotation must be in accordance with the arrow figuring on the pump.
- ☞ Adjust the operating point by slowly closing the shut-off device of the delivery line. If there is no shut-off device installed, the operating point will be adjusted automatically in accordance with the pump curve.

### WARNING

***Do not run the pump with a closed delivery line for a longer period of time. This may heat up the fluid inside the pump housing and thus damage interior components of the pump!***

### WARNING

***Always protect the pump from coarse impurities and magnetisable metal particles!***

## 6.3 Operation

If the motor has been switched off by the motor protection switch, proceed as follows:

- ☞ Before switching on the motor again, check whether the impeller rotates readily.
- ☞ Make sure that the suction line and the pump housing are filled with fluid.
- ☞ Switch on the motor.

If the pump only delivers for a short period of time and then stops delivering, the magnetic clutch has been disengaged. Proceed as described in chapter 8 below.

## 6.4 Shutdown procedure

- ☞ Switch off the motor.
- ☞ Close all shut-off devices.
- ☞ In case some fluid remains within the pump, secure the shut-off devices to prevent an accidental opening.

## 6.5 Safe disposal of waste parts

This product as a whole as well as parts of it must be disposed of in an environmentally safe way:

### WARNING

***Please comply with the respective regulations that are currently in force at your place (especially with regard to electronic scrap) !***

As for Germany:

Used parts that have been cleaned will be accepted by the local public disposal sites.

## 7 Maintenance

### 7.1 General information

The pump is designed for continuous operation and is therefore maintenance-free.

## 7.2 Preventive maintenance

- ☞ Clean the ventilator cowl at least **once per month** in order to prevent the motor from overheating!!
- ☞ Although bearings, center shaft and thrust rings are also designed for continuous operation, they should periodically be inspected for choking. If dirty, silty or crystallising fluids are delivered, then the pump should be inspected.

### WARNING

***Make sure there are no magnetisable metal particles in the working area if you assemble or disassemble the pump!***




***When the complete head of the pump is assembled or disassembled, magnetic forces can cause serious injury!***

- ☞ Check the static sealings in regular intervals and replace them, if necessary.

### 7.3 Disassembly of the pump


1. Remove the 6 screws (901.1) in the pump housing (101).

**Required tool: fork or ring spanner**

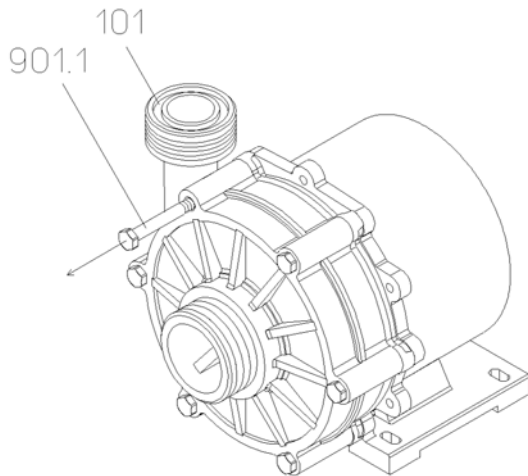


2. Take the complete head of the pump (001) off the lantern (113).

**Required tool: tire lever**

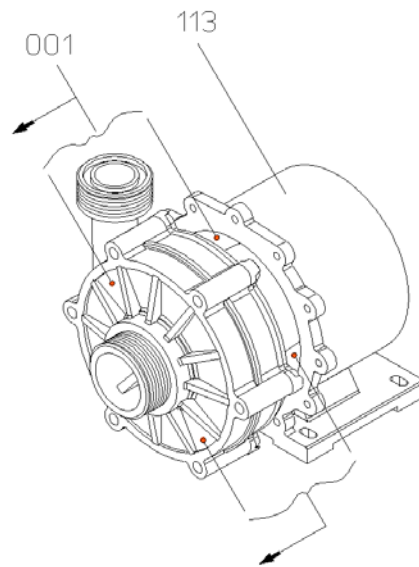


3. Take the pump housing (101) off the center shaft (211) and pull the impeller magnet (847.1) together with the impeller (230) out of the magnet dividing housing (161).

**No tools required!**

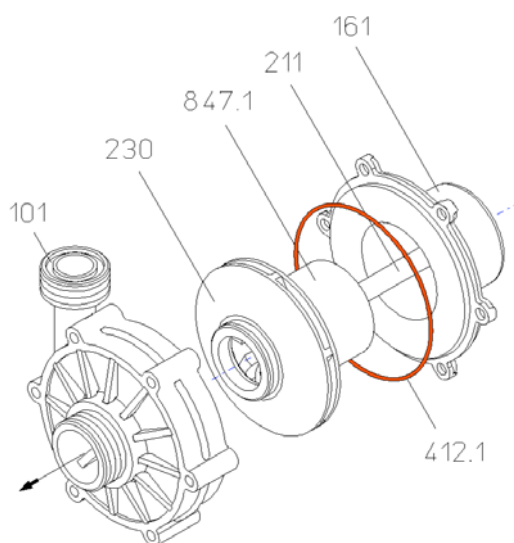


4. Remove the bearings (310.1 and 310.2) by forcing them backwards out of the impeller magnet (847.1).

**Required tools: hand lever press + pin Ø20mm!**

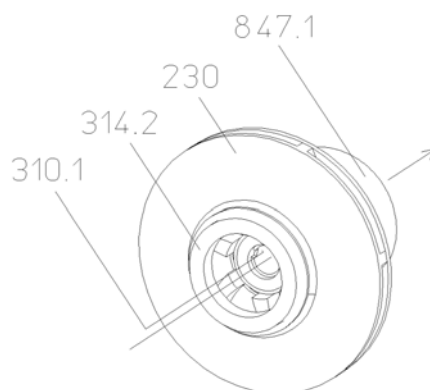


5. Remove the impeller (230) from the impeller magnet (847.1).

**Required tool: tire lever!**

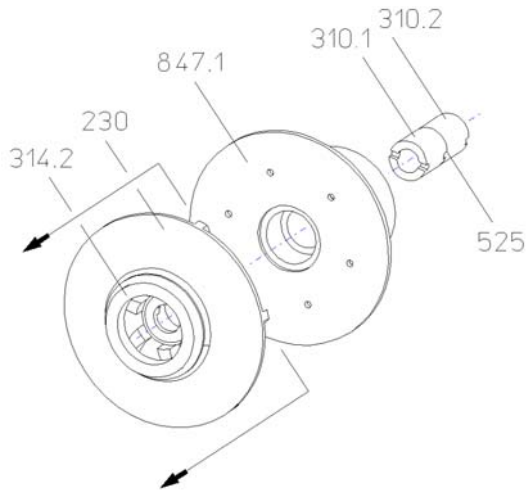

6. Take the thrust ring (314.2) off the impeller (230).


**Required tools: tubular piece  $\varnothing$ inside 80mm; driftpin  $\varnothing$ 6mm!**

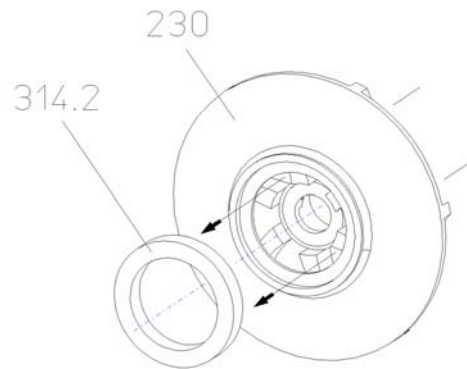

#### 7.4 Re-assembly of the pump


1. Assemble the bearings (310.1 and 310.2).

**Required tool: hand lever press!**

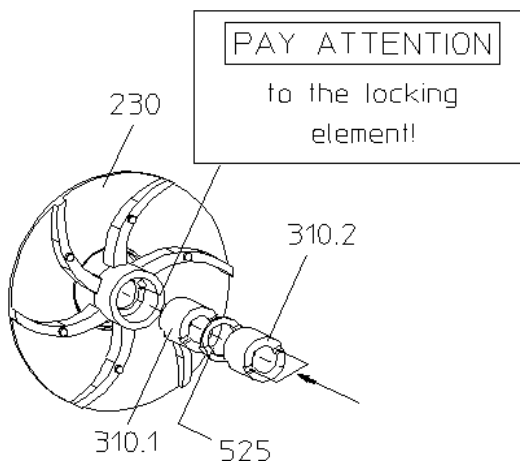

2. Press the impeller (230) onto the impeller magnet (847.1).

**Required tools: hand lever press + plastic pressure disk  $\varnothing$ 80mm!**

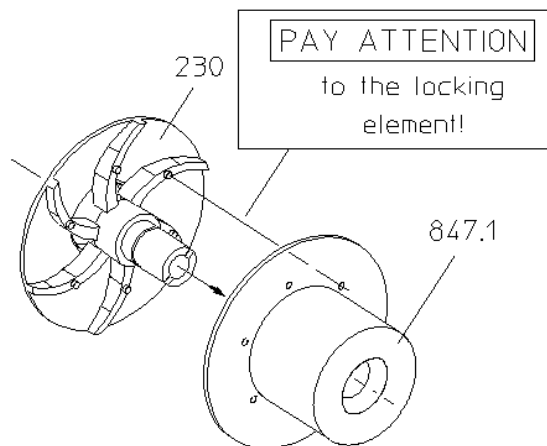

**WARNING**

***Once the complete head of the pump has been assembled, the impeller and impeller magnet (847.2) should be able to slide axially on the center shaft (211)!***

- Any other repair than the replacement of worn parts should be done by an expert, since inappropriate maintenance work usually results in unnecessary costs.
- If the pump will not be in operation for a longer period of time, it should be cleaned carefully. Otherwise you risk that residues remaining in the pump may harden and jam the impeller, once the pump is started again.

## 8 Troubleshooting

Malfunction	Causes	Corrective action
Pump does not work when switched on	No voltage	Test the voltage
	Impurities in the pump housing	Remove the impurities
Magnetic clutch is disengaged	Specific gravity and/or viscosity of the fluid is too high	Reduce the delivery rate; use a stronger magnetic clutch and a more powerful motor
	Pump was switched off, then switched on again before the rotor stopped	The rotor should have stopped before the pump can be switched on again
Motor is overheating	Clogged ventilator cowl	Clean the ventilator and the cowl
Pump is working, but not delivering	Gas accumulation in the lines	Evacuate the lines
Too much flow noise	Cavitation	Increase the suction line cross-section
		Reduce the delivery rate
		cool down the fluid
Pump is not sucking	No fluid in the pump	Open the vane
Delivery rate too low	Air in the system	Evacuate the system
	Suction and delivery line cross-sections are too small (significant losses)	Increase the suction and delivery line cross-sections
	Valve is not entirely open	Entirely open the valve
Delivery rate too high	Pump losses are less significant than presumed	Install a flow control valve in the delivery line


## 9 Technical data

Order-No.	1023094	1023100	1028566	1028572
Pump type	von Taine® 2323 PP/FKM	von Taine® 2323 PVDF/FKM	von Taine® 2323 PP/EPDM	von Taine® 2323 PVDF/EPDM
<b>Hydraulic data</b>				
Maximum flow	22500 l/h	22500 l/h	22500 l/h	22500 l/h
Operating range	120 - 22500 l/h	120 - 22500 l/h	120 - 22500 l/h	120 - 22500 l/h
Maximum head	23,5 mWC	23,5 mWC	23,5 mWC	23,5 mWC
Maximum system pressure at 20°C	5,0 bar	6,0 bar	5,0 bar	6,0 bar
<b>Electrical data</b>				
Motor output	1,5 kW	1,5 kW	1,5 kW	1,5 kW
Rated voltage <sub>50 Hz</sub> [V]	230/400	230/400	230/400	230/400
Rated voltage <sub>50 Hz</sub> [A]	5,6 / 3,25	5,6 / 3,25	5,6 / 3,25	5,6 / 3,25
No. of revolutions <sub>50 Hz</sub> [rpm]	2799	2799	2799	2799
cos φ	0,86	0,86	0,86	0,86
Protection class	IP 55	IP55	IP 55	IP55
Temperature class	F	F	F	F
<b>Further data</b>				
Maximum temperature of the medium	80 °C	95 °C	80 °C	95 °C
Maximum viscosity	<20 mPas	<20 mPas	<20 mPas	<20 mPas
Maximum ambient temperature	40 °C	40 °C	40 °C	40 °C
Maximum density of the medium	1,0 - 2,0 kg/dm <sup>3</sup>	1,0 - 2,0 kg/dm <sup>3</sup>	1,0 - 2,0 kg/dm <sup>3</sup>	1,0 - 2,0 kg/dm <sup>3</sup>
Suction port	G 2 1/4	G 2 1/4	G 2 1/4	G 2 1/4
Discharge port	G 2	G 2	G 2	G 2
Pump housing	PP	PVDF	PP	PVDF
Impeller	PP	PVDF	PP	PVDF
Colour of delivery unit	black	white	black	white
Bearing	oxide ceramic	oxide ceramic	oxide ceramic	oxide ceramic
Center shaft	oxide ceramic	oxide ceramic	oxide ceramic	oxide ceramic
Thrust ring (impeller)	teflon-graphite	teflon-graphite	teflon-graphite	teflon-graphite
Thrust ring (housing)	oxide ceramic	oxide ceramic	oxide ceramic	oxide ceramic
Sealing material	FKM	FKM	EPDM	EPDM
Colour of the motor	RAL 2003	RAL 2003	RAL 2003	RAL 2003
Weight	17,0 kg	17,7 kg	17,0 kg	17,7 kg
Dimensions LxTxH [mm]	430x205x227	430x205x227	430x205x227	430x205x227



## 10 Spare parts

### 10.1 Exploded view

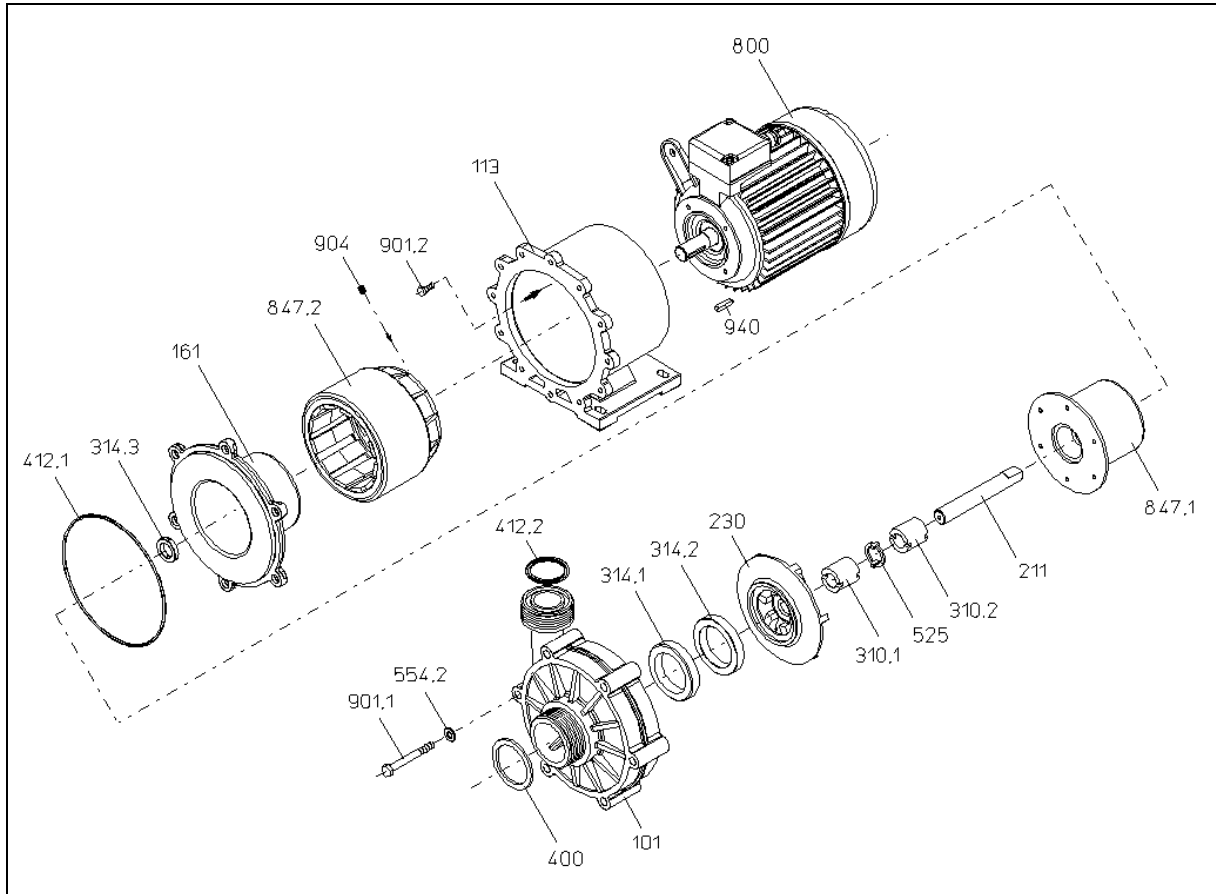

## 10.2 Bill of materials von Taine® 2323 PP/FKM

Serial-No: \_\_\_\_\_

Pos.	Qty.	Order-No.	Designation	Material	Qty.
101	1	PUMA.18.0240.140	pump housing without thrust ring	polypropylene	
113	1	PUMA.00.0750.010	lantern 60mm	Al	
161+314.3	1	PUMA.18.0240.017	rear casing 60mm with thrust ring	polypropylene	
211	1	PUMA.18.0240.105	center shaft 60mm	oxide ceramic	
230	1	PUMA.24.0340.025	impeller Ø135/3,8mm	polypropylene	
310.1	1	PUMA.18.0240.085	bearing	oxide ceramic	
310.2	1	PUMA.18.0240.085	bearing	oxide ceramic	
314.1	1	PUMA.18.0240.065	thrust ring (housing)	oxide ceramic	
314.2	1	PUMA.18.0240.070	thrust ring (impeller)	teflon-graphite	
400	1	PUMA.18.0240.039	flat packing (suction side)	FKM	
412.1	1	PUMA.18.0240.020	o-ring 160x3	FKM	
412.2	1	PUMA.18.0240.055	o-ring 40x5	FKM	
525	1	PUMA.18.0240.120	distance washer 2,2mm	polypropylene	
554.2	6	PUMA.18.0240.050	plain washer Ø8,4mm	A2 - DIN125	
800	1	PUMA.04.B.07 0007	motor 1,5kW 230/400V 50Hz		
847.1	1	PUMA.24.0340.075	inner magnet Ø135mm	polypropylene	
847.2	1	PUMA.30.0350.010	drive magnet 60(60S)		
901.1	6	PUMA.18.0240.045	hexagon head cap screw M8x70	A2 - DIN931	
901.2	4	PUMA.00.0750.021	hexagon head cap screw M6x16	A2 - DIN933	
904	1	PUMA.05.0050.007	threaded pin M6x10	45H - DIN914	
940	1	PUMA.00.1100.035	feather 6x6x25		

## 10.3 Bill of materials von Taine® 2323 PVDF/FKM

Serial-No: \_\_\_\_\_

Pos.	Qty.	Order-No.	Designation	Material	Qty.
101	1	PUMA.18.0240.142	pump housing without thrust ring	PVDF	
113	1	PUMA.00.0750.010	lantern 60mm	Al	
161+314.3	1	PUMA.18.0240.018	rear casing 60mm with thrust ring	PVDF	
211	1	PUMA.18.0240.105	center shaft 60mm	oxide ceramic	
230	1	PUMA.24.0340.029	impeller Ø135/3,8mm	PVDF	
310.1	1	PUMA.18.0240.085	bearing	oxide ceramic	
310.2	1	PUMA.18.0240.085	bearing	oxide ceramic	
314.1	1	PUMA.18.0240.065	thrust ring (housing)	oxide ceramic	
314.2	1	PUMA.18.0240.070	thrust ring (impeller)	teflon-graphite	
400	1	PUMA.18.0240.039	flat packing (suction side)	FKM	
412.1	1	PUMA.18.0240.020	o-ring 160x3	FKM	
412.2	1	PUMA.18.0240.055	o-ring 40x5	FKM	
525	1	PUMA.18.0240.121	distance washer 2,2mm	PVDF	
554.2	6	PUMA.18.0240.050	plain washer Ø8,4	A2 - DIN125	
800	1	PUMA.04.B.07 0007	motor 1,5kW 230/400V 50Hz		
847.1	1	PUMA.24.0340.076	inner magnet Ø135mm	PVDF	
847.2	1	PUMA.30.0350.010	drive magnet 60(60S)		
901.1	6	PUMA.18.0240.045	hexagon head cap screw M8x70	A2 - DIN931	
901.2	4	PUMA.00.0750.021	hexagon head cap screw M6x16	A2 - DIN933	
904	1	PUMA.05.0050.007	threaded pin M6x10	45H - DIN914	
940	1	PUMA.00.1100.035	feather 6x6x25		

## 10.4 Bill of materials von Taine® 2323 PP/EPDM

Serial-No: \_\_\_\_\_

Pos.	Qty.	Order-No.	Designation	Material	Qty.
101	1	PUMA.18.0240.140	pump housing without thrust ring	polypropylene	
113	1	PUMA.00.0750.010	lantern 60mm	Al	
161+314.3	1	PUMA.18.0240.017	rear casing 60mm with thrust ring	polypropylene	
211	1	PUMA.18.0240.105	center shaft 60mm	oxide ceramic	
230	1	PUMA.24.0340.025	impeller Ø135/3,8mm	polypropylene	
310.1	1	PUMA.18.0240.085	bearing	oxide ceramic	
310.2	1	PUMA.18.0240.085	bearing	oxide ceramic	
314.1	1	PUMA.18.0240.065	thrust ring (housing)	oxide ceramic	
314.2	1	PUMA.18.0240.070	thrust ring (impeller)	teflon-graphite	
400	1	PUMA.18.0240.040	flat packing (suction side)	EPDM	
412.1	1	PUMA.18.0240.021	o-ring 160x3	EPDM	
412.2	1	PUMA.18.0240.056	o-ring 40x5	EPDM	
525	1	PUMA.18.0240.120	distance washer 2,2mm	polypropylene	
554.2	6	PUMA.18.0240.050	plain washer Ø8,4mm	A2 - DIN125	
800	1	PUMA.04.B.07 0007	motor 1,5kW 230/400V 50Hz		
847.1	1	PUMA.24.0340.075	inner magnet Ø135mm	polypropylene	
847.2	1	PUMA.30.0350.010	drive magnet 60(60S)		
901.1	6	PUMA.18.0240.045	hexagon head cap screw M8x70	A2 - DIN931	
901.2	4	PUMA.00.0750.021	hexagon head cap screw M6x16	A2 - DIN933	
904	1	PUMA.05.0050.007	threaded pin M6x10	45H - DIN914	
940	1	PUMA.00.1100.035	feather 6x6x25		

## 10.5 Bill of materials von Taine® 2323 PVDF/EPDM


Serial-No: \_\_\_\_\_

Pos.	Qty.	Order-No.	Designation	Material	Qty.
101	1	PUMA.18.0240.142	pump housing without thrust ring	PVDF	
113	1	PUMA.00.0750.010	lantern 60mm	Al	
161+314.3	1	PUMA.18.0240.018	rear casing 60mm with thrust ring	PVDF	
211	1	PUMA.18.0240.105	center shaft 60mm	oxide ceramic	
230	1	PUMA.24.0340.029	impeller Ø135/3,8mm	PVDF	
310.1	1	PUMA.18.0240.085	bearing	oxide ceramic	
310.2	1	PUMA.18.0240.085	bearing	oxide ceramic	
314.1	1	PUMA.18.0240.065	thrust ring (housing)	oxide ceramic	
314.2	1	PUMA.18.0240.070	thrust ring (impeller)	teflon-graphite	
400	1	PUMA.18.0240.040	flat packing (suction side)	EPDM	
412.1	1	PUMA.18.0240.021	o-ring 160x3	EPDM	
412.2	1	PUMA.18.0240.056	o-ring 40x5	EPDM	
525	1	PUMA.18.0240.121	distance washer 2,2mm	PVDF	
554.2	6	PUMA.18.0240.050	plain washer Ø8,4	A2 - DIN125	
800	1	PUMA.04.B.07 0007	motor 1,5kW 230/400V 50Hz		
847.1	1	PUMA.24.0340.076	inner magnet Ø135mm	PVDF	
847.2	1	PUMA.30.0350.010	drive magnet 60(60S)		
901.1	6	PUMA.18.0240.045	hexagon head cap screw M8x70	A2 - DIN931	
901.2	4	PUMA.00.0750.021	hexagon head cap screw M6x16	A2 - DIN933	
904	1	PUMA.05.0050.007	threaded pin M6x10	45H - DIN914	
940	1	PUMA.00.1100.035	feather 6x6x25		

Subject to technical alteration!

## 11 Appendix

### 11.1 Dimensional drawing von Taine® 2323 PP and PVDF

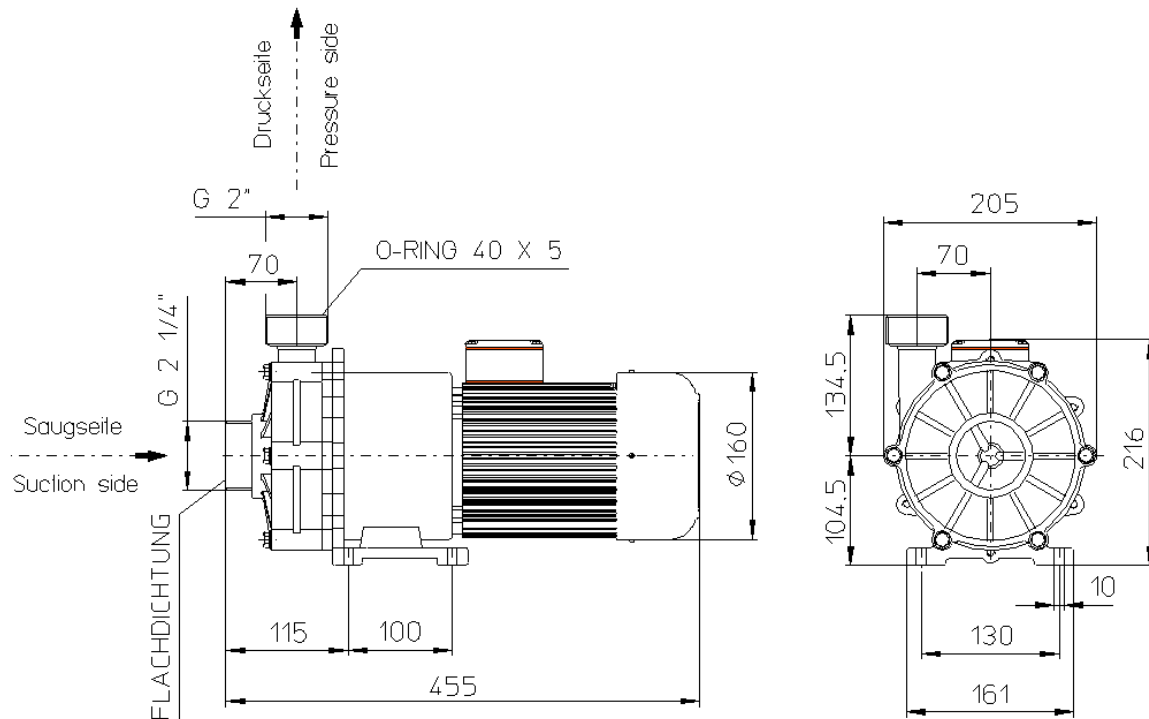


G = Aussengewinde / male thread

Technische Änderungen vorbehalten

Technical design may be subject to change


## 11.2 Characteristic curves

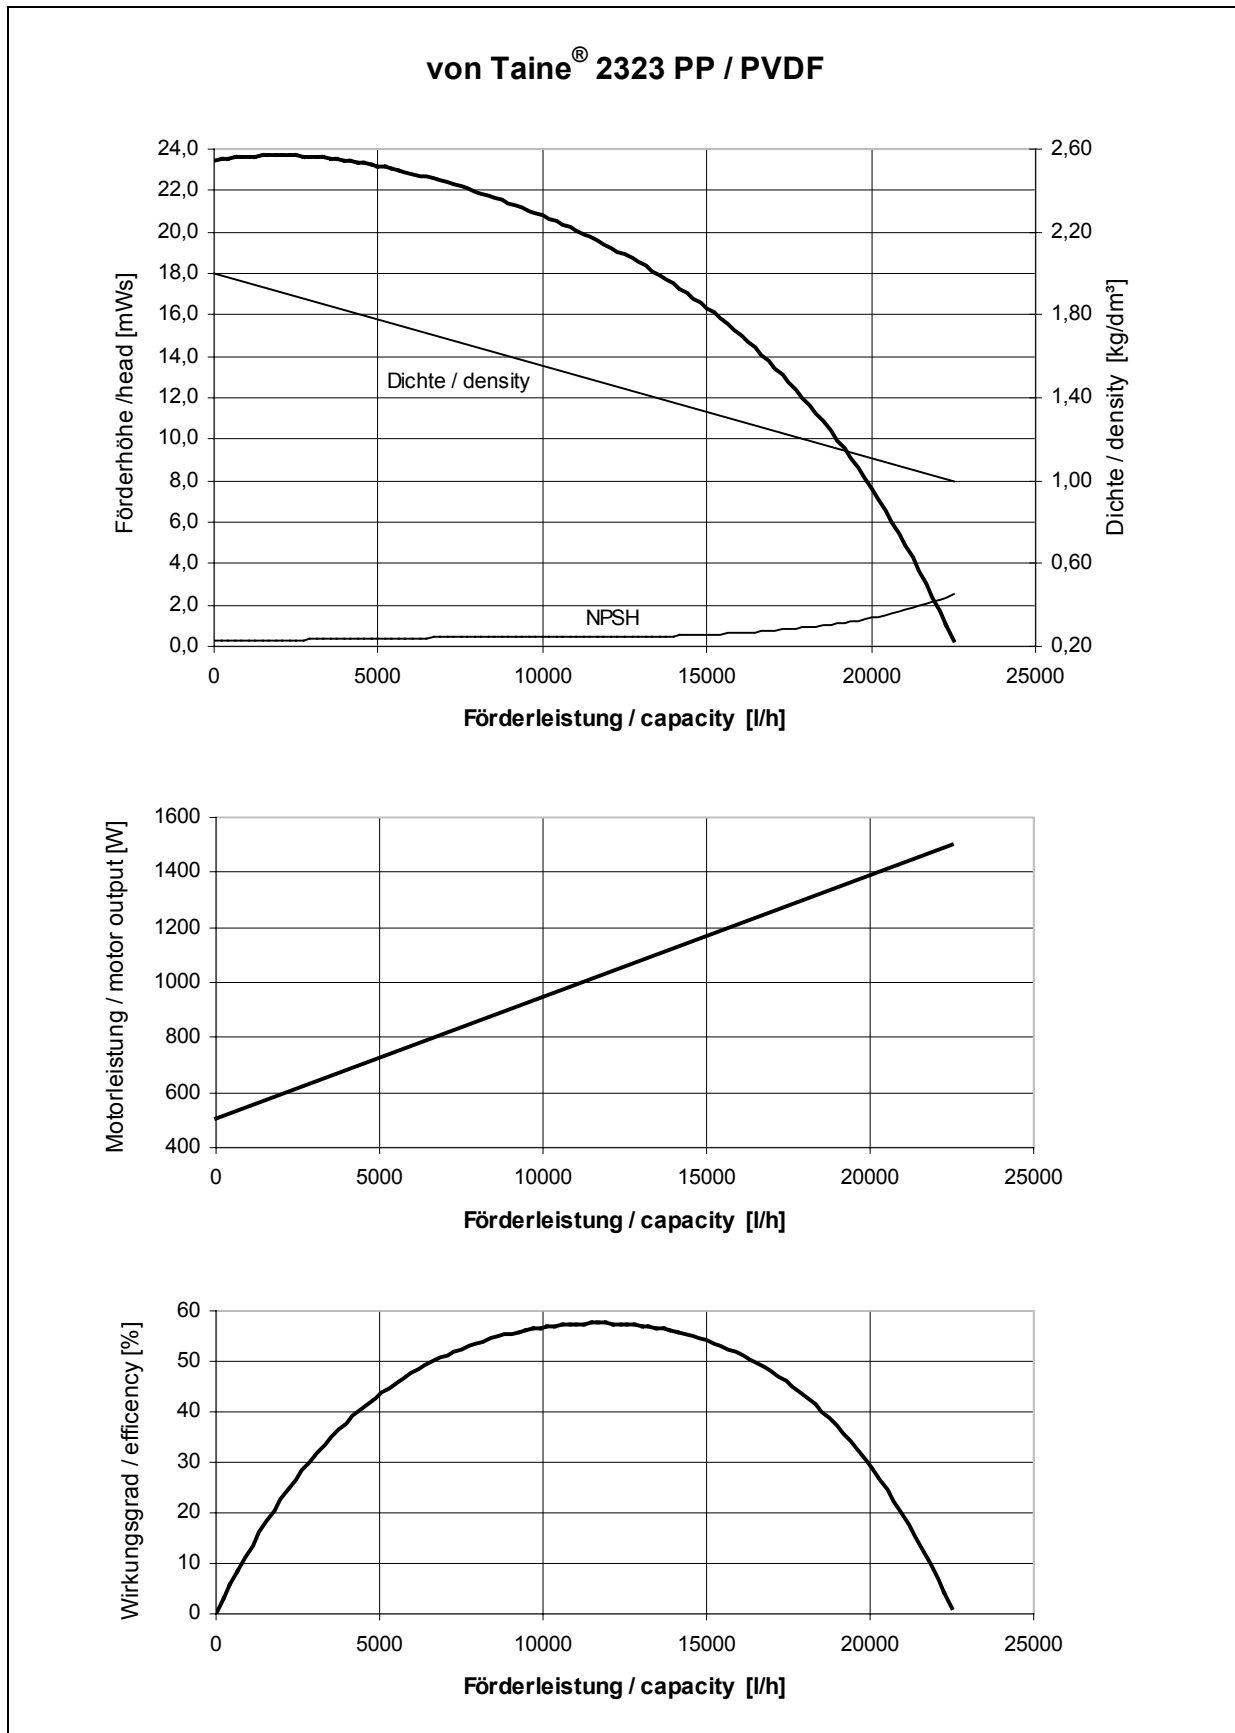

### 11.3 Motor data sheet

<h2>Motor Datenblatt</h2> <p>Motor data sheet Fiche technique pour moteur</p>					
<b>Motor-Typ</b> motor type type du moteur	St. 126/80-3		<b>Leistungsfaktor cosφ</b> power factor facteur de puissance	0,86 // 0,8	
<b>Maschinenart</b> type of machine désignation	3-ph. Motor		<b>Wirkungsgrad</b> efficiency rendement	77,0	%
<b>Bauform</b> mounting construction	IM B14		<b>Wärmeklasse</b> temperature class classe d'isolement	F	
<b>Bemessungsleistung</b> rated output puissance nominale	1,5	kW	<b>Anzugsstrom</b> starting current courant de démarrage	5,6	fach fold fois
<b>Schutzart</b> protection class degré de protection	IP55		<b>Anzugsmoment</b> starting torque couple de démarrage	2,9	fach fold fois
<b>Bemessungsspannung</b> rated voltage tension nominale	220-240/380-415 // 255-277 / 440-480V		<b>Kippmoment</b> pull-out torque couple de décrochage	2,93	fach fold fois
<b>Bemessungsstrom</b> rated current courant nominal	5,6 / 3,25 // 5,0 / 2,9		<b>Umgebungstemperatur</b> ambient temperature température ambiante	max. 40 °C	
<b>Bemessungsfrequenz</b> rated frequency fréquence nominale	50 // 60Hz		<b>Schaltung</b> connection branchement	triangle/ star	
<b>Bemessungsdrehzahl</b> rated speed vitesse nominale	2799 // 3430	U/min. rpm t/mn	<b>Identcode</b> identcode code d'identification		
<b>Pumpentyp</b> pump type type de pompe	Magnetically coupled centrifugal pump		Kondensator Capacitor Condensateur	-	
<b>Anmerkung</b> comment remarque	Die Daten entsprechen den Angaben der Motorenhersteller. Kenndaten funktionsgleicher Motoren anderer Hersteller ändern sich nur unwesentlich. Angabe ohne Gewähr.				
	The data correspond to the details given by the motor manufacturers. Ratings of motors with the same functions made by other producers show insignificant changes only. This information is supplied without liability.				
	Les données techniques correspondent au descriptif du fabricant des moteurs. Les données techniques de moteurs similaires chez d'autres fabricants varient très peu. Ces données sont d'ordre général.				
<b>ProMinent Dosiertechnik GmbH · 69123 Heidelberg · Germany</b>				Nr. / No.	
				Datum / Date 12.04.2006	

## 11.4 EC Declaration of Conformity

<b>EC Declaration of Conformity</b>	
We hereby declare,	<b>ProMinent Dosiertechnik GmbH Im Schuhmachergewann 5 - 11 D - 69123 Heidelberg</b>
that the following designated product complies with the pertinent fundamental safety and health requirements of the EC Directive in terms of its design and construction and in terms of the version marketed by us. This declaration loses its validity in the event of a modification to the product not agreed with us.	
Description of the product:	<b><i>Circulation pump</i></b>
Product type:	<b><i>vonTAINÉ</i></b>
Serial no.:	<b><i>refer to nameplate on the device</i></b>
Pertinent EC Directives:	<b><i>EC Machinery Directive (2006/42/EC) EC Low Voltage Directive (2006/95/EC) EC EMC Directive (2004/108/EC)</i></b>
Applied harmonised standards in particular:	<b><i>EN ISO 12100-1, EN ISO 12100-2, EN 809</i></b>
technical documents have been compiled by:	<b><i>Norbert Berger Im Schuhmachergewann 5-11 DE-69123 Heidelberg</i></b>
Date / Manufacturer - Signature :	<b><i>04.01.2010</i></b> 
Details of the signatory:	<b><i>Joachim Schall, Head of Research and Development</i></b>

**Anschriften- und Liefernachweis durch den Hersteller /**  
**Addresses and delivery by the manufacturer /**  
**Adresses et liste des fournisseurs fournies par le constructeur /**  
**Para informase de las direcciones de los distribuidores, dirigirse al fabricante**

ProMinent® Dosiertechnik GmbH  
Im Schuhmachergewann 5-11 • 69123 Heidelberg  
Germany  
Tel.: +49 6221 842-0  
Fax. +49 6221 842-419  
info@prominent.de  
www.prominent.de